

VAG BETA[®] 200 Gate Valve



Table of Contents

1	General	3
1.1	Safety	3
1.2	Proper use	3
1.3	Identification	3
2	Transport and Storage	3
2.1	Transport	3
2.2	Storage	4
3	Product features	4
3.1	Features and function description	4
3.2	Applications	5
3.3	Permissible and impermissible modes of operation	5
4	Installation into the pipeline	5
4.1	Conditions required on site	5
4.2	Installation location	5
4.3	Installation position	5
4.4	Assembly instructions and fittings	6
5	Set-up and operation of the valve	6
5.1	Visual inspection and preparation	6
5.2	Function check and pressure test	6
6	Actuators	6
6.1	General	6
6.2	Operating torques	6
7	Maintenance and repair	6
7.1	General safety instructions	6
7.2	Inspection and operation intervals	7
7.3	Parts list	7
8	Trouble-shooting	7
9	How to contact us	7

VAG reserves the right to make technical changes and use materials of similar or better quality without prior notice. The pictures used are typical and non-binding.

1 General

1.1 Safety



These Operation and Maintenance Instructions must be observed and applied at all times along with the general "VAG Installation and Operation Instructions for Valves" (see www.vag-group.com / Category: Installation and Operation Instructions).

Arbitrary alterations of this product and the parts supplied with it are not allowed. VAG will not assume any liability for consequential damage due to non-compliance with these instructions.

When using this valve, the generally acknowledged rules of technology have to be observed (e.g. DIN standards, DVGW data sheets (e.g. DIN standards, DVGW Instruction Sheets W332 and W392, VDI guidelines etc.) The installation must only be carried out by qualified staff (see also Section 7.1 General safety instructions). For further technical information such as dimensions, materials or applications please refer to the respective documentation (KAT -A 1010).

VAG valves are designed and manufactured to the highest standards and their safety of operation is generally ensured. However, valves may be potentially dangerous if they are operated improperly or are not installed for their intended use.

All personnel dealing with the assembly, disassembly, operation, maintenance and repair of the valves must have read and understood the complete Operating and Maintenance Instructions (Accident Prevention Regulations, VBG 1 §§ 14 and following [Regulations issued by the Trade Associations] and ANSI Z535).

Before removing any protective devices and/or performing any work on the valves, depressurise the pipeline section and ensure it is free of hazards. Unauthorised, unintentional and unexpected actuation as well as any hazardous movements caused by stored energy (pressurised air, water under pressure) must be prevented.

In the case of equipment that must be monitored and inspected, all relevant laws and regulations, such as the Industrial Code, the Accident Prevention Regulations, the Ordinance of Steam Boilers and instructional pamphlets issued by the Pressure Vessels Study Group must be complied with. In addition, the local accident prevention regulations must be observed.

When a valve needs to be dismantled from a pipeline, fluid may emerge from the pipeline or the valve. The pipeline must be emptied completely before the valve is dismantled. Special care needs to be taken in case of residues which may continue flowing.

1.2 Proper use

The VAG BETA® 200 Gate Valve is a resilient-seated shut-off valve for installation in pipelines.

VAG BETA® 200 Gate Valves are used to shut-off the medium present in the pipeline. In plant construction and in the construction of buried pipelines, VAG BETA® 200 Gates Valves are used for OPEN/CLOSED operation of pipelines. By turning the operation element (e.g. the handwheel) clockwise (i.e. to the right - standard version) the valve is closed and by turning the operating element to the left, the valve is opened. It is not possible to use this valve as a control valve. Continuous operation of the valve in an intermediate position will lead to increased wear and should therefore be avoided. For specific control tasks other types of valves should be used.

VAG BETA® 200 Gate Valves meet the requirements of the standard DIN EN 1074 Part 1 and Part 2.

For the respective technical application ranges (e.g. operating pressure, medium and temperature) please refer to the specific product-related documentation (KAT-A 1010)

VAG BETA® 200 Gate Valves can be pressurised in both flow directions.

For any deviating operating conditions and applications, the manufacturer's written approval must be obtained!

These Operation and Maintenance Instructions contain important information on the safe and reliable operation of the VAG BETA® 200 Gate Valves.

Observing these Operation and Maintenance Instructions helps you to:

- Prevent hazards
- Reduce repair costs and down-time of the valve and/or the entire plant
- Improve the operational safety and useful life expectancy of the equipment

1.3 Identification

According to DIN EN 19 all valves bear an identification label specifying the nominal diameter (DN), nominal pressure (PN), body material and the manufacturer's logo.

A rating plate is attached to the body and contains at least the following information:

VAG	Manufacturer's name
DN	Nominal diameter of the valve
PN	Nominal pressure of the valve
	Date of manufacture

2 Transport and Storage

2.1 Transport

For transportation to its installation site, the valve must be packed in stable packaging material suitable for the size of the valve. Ensure that the valve is protected against atmospheric influences and external damage. When the valve is shipped under specific climatic conditions (e.g. overseas transport), it must be specially protected and wrapped in plastic film and a desiccant must be added.

The factory-applied corrosion protection and any assemblies must be protected against damage by external influences during transport and storage.

The VAG BETA® 200 Gate Valve should be transported slightly open and with the wedge unstressed. The valve should rest safely and in a stable position on one of its flanges (see Picture 1). It is advisable to fix the gate valve bonnet with wooden plates or sturdy cardboard to prevent the valve from resting on its stem square end.



Attention: When the VAG BETA® 200 Gate Valve is delivered, it is not completely open / closed. Before putting the valve in operation, adjust it to the desired position (open/close operation).



Picture 1: Transport position of the VAG BETA® 200 Gate Valves

When the valve is equipped with an actuator, ensure safe storage of the actuator to prevent transverse loads from acting on the connections.

For the selection and use of slings, the weight of the valve and the type of sling must be considered. The weights of the VAG BETA® 200 Gate Valves can be found in KAT-A 1010. The use of slings should comply with the relevant regulations.

Never lift or lower the load abruptly as the forces occurring in this case may damage both the valve and the lifting equipment.

For transport purposes and also to support assembly, lifting devices such as cables and belts must only be attached to the valve body. From nominal diameter DN 200 onwards, the end of the stem is equipped with an eyebolt as a standard to make lifting easier.

The length and positioning of the cables/belts must ensure that the valve is in a horizontal position during the entire lifting procedure.

For valves that have been factory-packed in transport crates (wooden crates), the centre of gravity of the entire unit must be taken into account. The centre of gravity is marked on each side of the crate at our factory and must be considered for all lifting operations.

2.2 Storage

Store the VAG BETA® 200 Gate Valve in a slightly open position and with the wedge unstressed. During storage, the valve should rest safely and in a stable position on one of its flanges (see Picture 1).

The elastomeric parts (seals) must be protected against direct sunlight and/or UV light as otherwise their long-term sealing function cannot be guaranteed. Store the valve in a dry and well-aerated place and avoid direct radiator heat. Protect any assembly units important for the function such as the wedge against dust and other dirt by adequate covering.

Do not remove the protective caps of the connections / flanges and the packaging materials until immediately prior to assembly.

The valve can be stored in ambient temperatures ranging from -20 °C to + 50 °C (protected by adequate covers). If the valve is stored at temperatures below 0 °C, it should be warmed up to at least +5° C before installation and before it is put into operation.

3 Product features

3.1 Features and function description

In general, VAG BETA® 200 Gate Valves serve the purpose of shutting off the medium. Due to their fully flanged design, they can be used both between two flanges and as end-of-line valves without counter-flange at full operating pressure.

As a standard, the valve is available in the following types (see Picture 2):

- Face-to-face length to EN 558-1, Basic Series 14 (DIN 3202, F4)
- Face-to-face length to EN 558-1, Basic Series 15 (DIN 3202, F5)
- Face-to-face length to EN 558-1, Basic Series 15 (DIN 3202, F5) +/-5 mm (DN 80-200), -10/+5 mm (DN 250-300) (VAG BETA® 200 TS Replacement Gate Valve)

In addition to these types, varieties with BAIO® Socket Connection and BAIO® Socket / Spigot End are available. See Installation and Operation Instructions of the VAG BAIO®*plus* System.

The following types of coatings are available:

- True enamel on the inside and epoxy coating on the outside
- Epoxy coating on the inside and outside



Picture 2: Standard types of the VAG BETA® 200 Gate Valve

3.2 Applications

Due to the EPDM materials used for the seals, VAG BETA® 200 Gate Valves can be used with the following media:

- Water
- Raw water and cooling water

The use of media containing fat, oil and gas may cause the destruction of the rubber coated wedge I and the O rings and is therefore not allowed.

VAG BETA® 200 Gates Valves should only be used in media in which there is no risk of clogging.

For information about the corresponding temperature limits, please refer to the product-related technical documentation (KAT- A 1010)

In case of deviating operating conditions and applications, please consult the manufacturer.

3.3 Permissible and impermissible modes of operation

The maximum operating temperatures and operating pressures specified in the technical documentation (KAT-A 1010) must not be exceeded.

The pressure applied to the closed valve must not exceed its rated pressure.

The maximum permissible flow velocity (at stable flow) is that specified in the EN 1074-1 standard.

- PN 6 - 2,5 m/s
- PN 10 - 3 m/s
- PN 16 - 4 m/s
- PN 25 - 5 m/s

Ausnahmen bedürfen der ausdrücklichen schriftlichen Zustimmung des Herstellers.

Any exceptions from the above require the manufacturer's express written approval.

If the valve is operated in turbulent flows (e.g. installed downstream of elbows or similar sections) the flow velocity must be reduced accordingly in consultation with the manufacturer. If this is not possible, maintenance intervals must be shorter.

VAG BETA® 200 Gate Valves are suitable for open/close operation only. Continuous operation of the valve in an intermediate position will lead to increased wear and should therefore be avoided. For specific control tasks other types of valves should be used.

4 Installation into the pipeline

4.1 Conditions required on site

When installing the valve between two pipeline flanges, these must be coplanar and in alignment. If the pipes are not in alignment, they must be aligned before installation of the valve, as otherwise this may result in impermissibly high loads acting on the valve body during operation, which may eventually even lead to fracture.

When installing the valve into the pipeline, make sure it is as ten-

sion-free as possible. The space between the flanges should be wide enough to prevent damage to the coating of the flange gasket frames during installation.

In case of works around the valve causing dirt (e.g. painting, masonry or working with concrete), the valve must be protected by adequate covering.

For assembly in drinking water pipelines, suitable sealing materials, lubricants and process materials must be used which are approved for use in drinking water pipelines.

Before putting the valve into operation, clean and purge the corresponding pipeline sections.

4.2 Installation location


The installation location of the valve must be selected to provide sufficient space for function checks and maintenance works (e.g. dismantling and cleaning of the valve).

If the valve is installed in the open, it must be protected against extreme atmospheric influences (e.g. formation of ice etc.) by adequate covers.

When installing the valve as an end-of-line valve, make sure in particular that the free outlet side cannot be accessed by people.

4.3 Installation position

In drinking water (technical clean medium), the VAG BETA® 200 Gate Valve can be installed in any position.

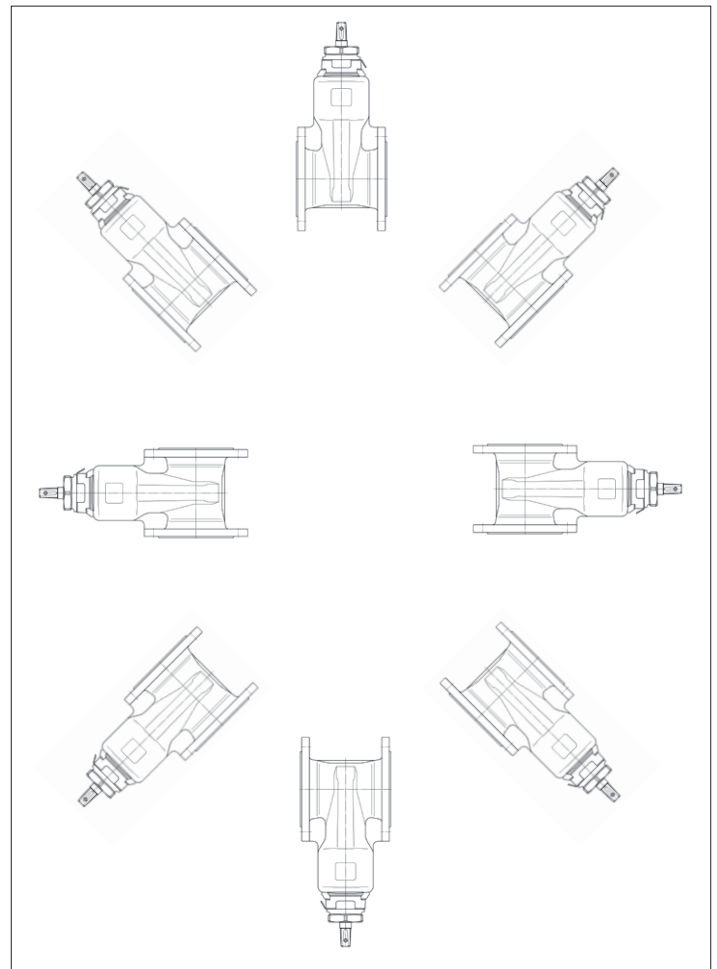

Picture 3: Installation positions of the valve

4.4 Assembly instructions and fittings

Check the valve for possible damage that it may have occurred during transport or storage. Protect the valve against dirt from the construction site by adequate covering until installation. Prior to installation all components essential for proper function, such as the wedge and in general the inner surfaces of the valve must be thoroughly cleaned to remove all dirt particles. VAG does not assume any liability for consequential damage caused by dirt, shot-blasting gravel residue etc.

The function parts should be checked for proper operation prior to installation.

Should the valves be repainted later on, it must be ensured that no paint is applied to the functional parts. The identification plates must not be painted over either. If the equipment is sand-blasted for any reason prior to installation, these parts must be adequately covered. If solvents are used for cleaning, you should ensure that they do not damage the seals of the pipeline or the valve.

For the assembly of the VAG BETA® 200 Gate Valve it must be ensured that proper load suspension devices as well as means of transport and lifting devices are available.

When connecting the valve with the pipeline flanges, hexagon bolts and nuts with washers from flange to flange must be used in the through holes.

Fasten the bolts evenly and crosswise to prevent unnecessary tension that may result in cracks or breaks in the flange. The pipeline must not be pulled towards the valve. Should the gap between valve and flange be too wide, this should be compensated by thicker seals.

We recommend using steel-reinforced rubber seals to DIN EN 1514-1 IBC Shape. If you use raised face flanges, the use of IBC gaskets is mandatory.

While the valve is being installed, it must be ensured that the flanges of the pipeline it is connected to are aligned and level with each other. Welding works on the pipeline must be performed before the valves are installed to prevent damage to the seals and the corrosion protection. Welding residue must be removed before the equipment is put into operation.

The pipeline must be laid in a way that prevents harmful pipeline forces from being transmitted to the valve body. Should construction works near or above the valve not be completed yet, the valve must be covered to protect it from dirt.

5 Set-up and operation of the valve

5.1 Visual inspection and preparation

Before putting the valve and the equipment into operation, perform a visual inspection of all functional parts. Check whether all bolted connections have been properly fastened.

Check whether the gate is soft-running. For this purpose, move the wedge of the gate valve over its entire stroke (OPEN – CLOSE). You can operate the valve either via a handwheel or an operating key to DIN 3223. Do not use excessive force.

The valves are maintenance free. The stem bearing of the VAG BETA® 200 Gate Valve is safe to run dry. Subsequent lubrication is not necessary.

5.2 Function check and pressure test

Prior to installation, the function parts of the valve have to be opened and closed completely at least once and should be checked for trouble-free operation.

The dimensions of the valve allow its operation by one person via a handwheel or an operating key. Extensions for operation are not admissible as they may cause damage to the valve due to excessive loads.

Warning!! The pressure exerted on the closed valve must not exceed its nominal pressure (see technical data sheet KAT-A 1010). When a pressure test is performed in the pipeline with a test pressure exceeding the admissible nominal pressure in closing direction, the pressure must be compensated by way of a bypass.

Newly installed pipeline systems should first be thoroughly purged to remove all foreign particles. If residues or dirt particles are present in the pipeline, they might clog the installations while the pipeline is being purged. This may impair the function of the valve or even block it.

In particular after repair work or upon the commissioning of new equipment, the pipeline system is to be purged again with the valve being fully open. If detergents or disinfectants are used it must be ensured they do not attack the valve materials

6 Actuators

6.1 General

Actuators (handwheel, operating key, installation equipment) are designed for flow velocities according to Table 2 in EN 1074-1 (valves used for water supply; requirements relating to fitness for use). Any deviating operating conditions need to be specified.

6.2 Operating torques

Operating torques are the maximum required torques [in Nm] acting on the actuator stem at full differential pressure. The maximum permissible operating torques are specified in DIN EN 1074-2, and for resilient-seated gate valves they are 1 x DN (e.g. DN 100 = 100 Nm).

7 Maintenance and repair

7.1 General safety instructions

Prior to the performance of inspection and maintenance work on the valve or its assemblies, shut-off the pressurised pipeline, depressurise it and secure it against inadvertent activation. Depending on the type and hazard risk of the fluid conveyed, comply with all required safety regulations!

After completing the maintenance works and before resuming operation, check all connections for tightness. Perform the steps described for initial set-up as described under Section 5 "Set-up and operation".

Statutory and local provisions as well as the safety and accident prevention regulations must be observed and complied with at all times.

Servicing, maintenance and inspection work as well as the replacement of spare parts must be carried out by qualified personnel. The plant operator is responsible for determining the suitability of

the personnel or for ensuring that they have all relevant qualifications.

In case the operator's employees do not have the qualifications required, they should attend a training course. Valve related training courses can be undertaken by VAG Service employees.

In addition to this, the plant operator needs to ensure that all employees have understood these Operation and Maintenance Instructions as well as all further instructions referred to in them.

Protective equipment such as safety boots, safety helmets, goggles, protective gloves etc. must be worn during all work requiring such protective equipment or for which such protective equipment is prescribed.

Improper or wrong use of the valve should be avoided. Prior to the performance of any work on the valve and equipment it must be ensured that the relevant pipeline section has been depressurised and/or de-energised.

7.2 Inspection and operation intervals

The valve should be checked for tightness, proper operation and corrosion protection at least once per year (DVGW Instruction Sheet W 392).

7.3 Parts list

The BETA® 200 Gate Valve is maintenance-free in terms of its service time according to EN 1074. Spare parts needed in addition to that can be found in the spare list of KAT 1010 E1 or E2.

8 Trouble-shooting

For all repair and maintenance work, please observe the general safety instructions described in Section 7.1

9 How to contact us

Head office

VAG GmbH

Carl-Reuther-Str. 1

68305 Mannheim

Germany

Phone: +49 (621) 749-0

Fax: +49 (621) 749-2153

info@vag-group.com

<http://www.vag-group.com>

Service

Our service hotline can be reached 24/7 world-wide. In case of emergency, please contact us by phone

Service hotline: +49 621 - 749 2222

Service per E-Mail: service@vag-group.com

Problem	Possible cause	Remedial action
Gate valve does not close	Stem nut defective	Replace stem nut
	Foreign particle on sealing face	Remove foreign particle
	Wedge defective	Replace wedge
	Stem distorted	Replace stem
	Heavy deposits on the sliding surfaces	Clean sliding surfaces
Gate valve does not open	Foreign particle is jamming wedge	Remove foreign particle
	Stem distorted	Replace stem
	Stem nut defective	Replace stem nut
Gate valve leaky at the bonnet	Stem bearing and bearing nut not properly fastened	Refasten stem bearing and stem nut
	Profiled seal defective	Replace profiled seal
Gate valve leaky at the stem bearing	O-rings defective	Replace o-rings
Defective O-rings in the stem bearing	Scraper ring defective (stem dirty)	Replace scraper ring

